DMX LED Driver 96 watt - Installation Instructions

MODELS PSDMX-96-24

Please read all instructions prior to installation and keep for future reference!

This LED Driver is to be installed in accordance with Article 450 of the National Electrical Code. The LED Driver must be installed in a well ventilated area and free from explosive gases and vapors. Proper operation requires the free flow of air. As this LED Driver is hardwired, it should only be installed by a qualified electrician. Suitable for Damp locations.


PLENUM FOR SUCH USE IN ACCORDANCE WITH UL2043


REV 1 . 1 07142023 7777 Merrimac Ave Niles, IL 60714 T 224.333.6033 F 224.757.7557 info@luminii.com www.luminii.com


₩ IIIUMin


1/3


Input	120 - 277 V AC, 1.1 A, 50/60 Hz
Output	24 V DC, 4.0 A
Max. Wattage	96 W





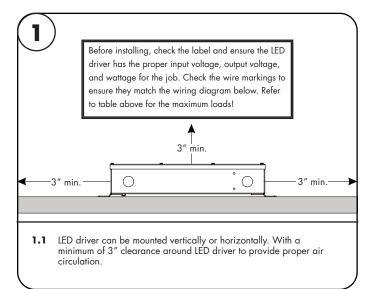

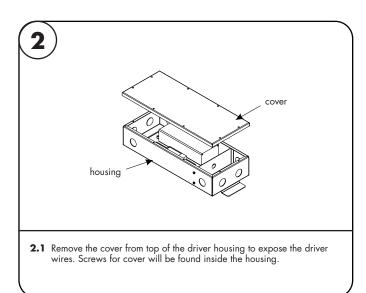

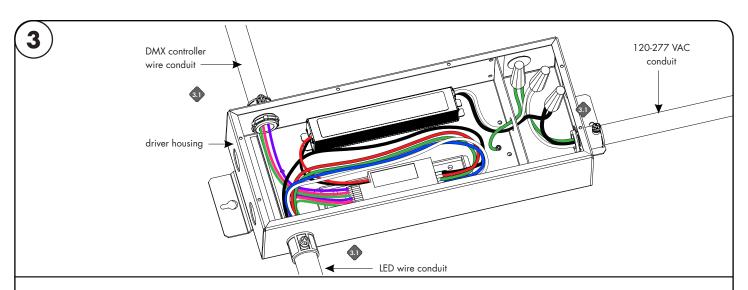

3.1 Insert the 120 - 277V AC power into the driver housing from the electrical panel. Followed by bringing 24V DC low voltage conduit one for the LED and other for the controller wires. Refer to diagram on page 2 to make all the proper wiring connections. Also, refer to page 3 to program decoder correctly.

DMX LED Driver 96 watt - Installation Instructions

MODELS PSDMX-96-24

Please read all instructions prior to installation and keep for future reference!


This LED Driver is to be installed in accordance with Article 450 of the National Electrical Code. The LED Driver must be installed in a well ventilated area and free from explosive gases and vapors. Proper operation requires the free flow of air. As this LED Driver is hardwired, it should only be installed by a qualified electrician. Suitable for Damp locations.


PLENUM FOR SUCH USE IN ACCORDANCE WITH UL2043


REV1.1 07142023


Niles, IL 60714 T 224.333.6033 F 224.757.7557 info@luminii.com www.luminii.com

2/3

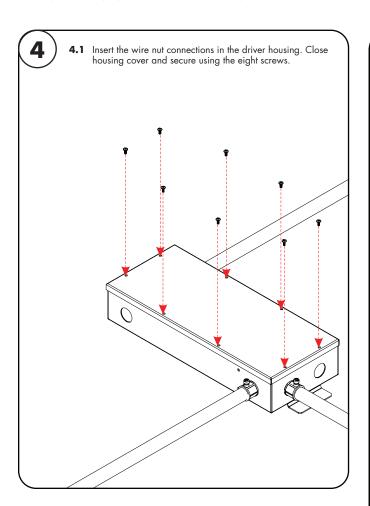

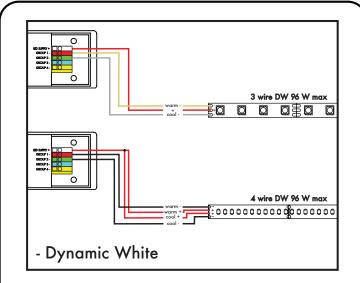

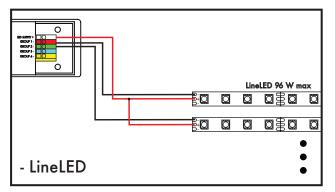

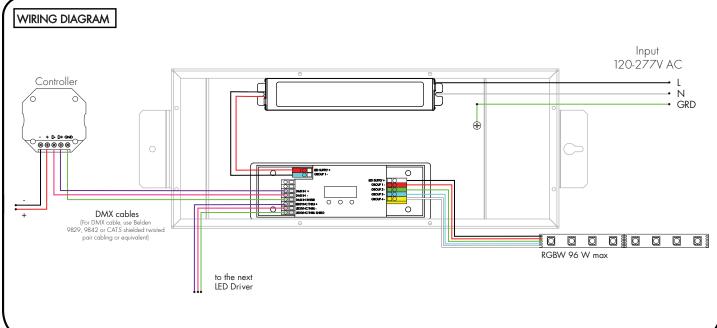

DMX LED Driver 96 watt - Installation Instructions

MODELS PSDMX-96-24

Please read all instructions prior to installation and keep for future reference!

This LED Driver is to be installed in accordance with Article 450 of the National Electrical Code. The LED Driver must be installed in a well ventilated area and free from explosive gases and vapors. Proper operation requires the free flow of air. As this LED Driver is hardwired, it should only be installed by a qualified electrician. Suitable for Damp locations.

PLENUM FOR SUCH USE IN ACCORDANCE WITH UL2043

REV1.1 07142023 Niles, IL 60714 T 224.333.6033 F 224.757.7557 info@luminii.com www.luminii.com

7777 Merrimac Ave


₩ IIIUMir

3/3


Programming the Decoder

Manual configuration


1. Select mode of operation:



2. Set LED groups:



3. Standalone operation or - Colour*-





(M) (M)

Standalone

operation

- Show -





or

Networked

- DMX -

⊙/⊕

(-)/(+)

COLR

operation


* The colour menu depends on the LED group settings you have selected in step 2.

Other features

Visual test run



Locking the configuration:



Reset to factory defaults

