

PS - Universal Power Supply - Installation Instructions

Model PS-PH-D-96-24-DC

Please read all instructions prior to installation and keep for future reference!

This power supply is to be installed in accordance with Article 450 of the National Electrical Code. The power supply must be installed in a well ventilated area and free from explosive gases and vapors. Proper operation requires the free flow of air. As this power supply is hardwired, it should be installed by a qualified electrician. UL class 2 recognized




REV.0.2
09192024



7777 Merrimac Ave
Niles, IL 60714
T 224.333.6033
F 224.757.7557
info@luminii.com
www.luminii.com

1 / 2

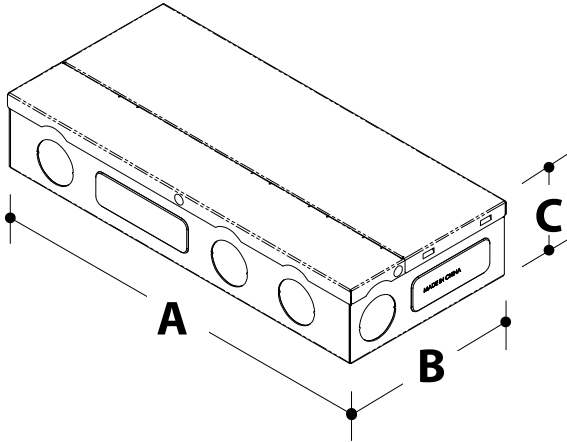

MODELS	PS-PH-D-96-24-DC
MAX Load	96 watts
A. Length	8.25"
B. Width	4.10"
C. Depth	1.56"
Net Weight	2.20 lbs

1 Before installing, check the label and ensure the power supply has the proper input voltage, output voltage, and wattage for the job. Check the wire markings to ensure they match the wiring diagram below. Refer to table above for the maximum loads!

3" min. (top clearance)
3" min. (left clearance)
3" min. (right clearance)

1.1 Power supply can be mounted vertically or horizontally. With a minimum of 3" clearance around power supply to provide proper air circulation.

2

2.1 screw
cover
screw
driver housing
screw

2.1 Remove the three Phillips screws from the top of the driver housing and pull the cover off to expose the driver wires.

3

mount
driver housing
120-277 VAC conduit
mount
24VDC conduit

3.1 Insert the 120-277 VAC power into the driver housing from the electrical panel. Followed by bringing the 24V DC low voltage wires from the LEDs into the driver housing. In addition, connect the Triac / Phase dimmer at input if applicable. Refer to diagram on page 2 to make all the proper wiring connections.

PS - Universal Power Supply - Installation Instructions

Model PS-PH-D-96-24-DC

Please read all instructions prior to installation and keep for future reference!

This power supply is to be installed in accordance with Article 450 of the National Electrical Code. The power supply must be installed in a well ventilated area and free from explosive gases and vapors. Proper operation requires the free flow of air. As this power supply is hardwired, it should be installed by a qualified electrician. UL class 2 recognized



REVO.2
09192024

2 / 2




7777 Merrimac Ave
Niles, IL 60714
T 224.333.6033
F 224.757.7557
info@luminii.com
www.luminii.com


4

WIRING DIAGRAM

NOTE: This unit needs to perform load calibration when use for the first time or load changed. Please run the unit with dimmer at max level for 10 seconds. During load calibration, output of the unit will delay for 2 - 3 seconds.

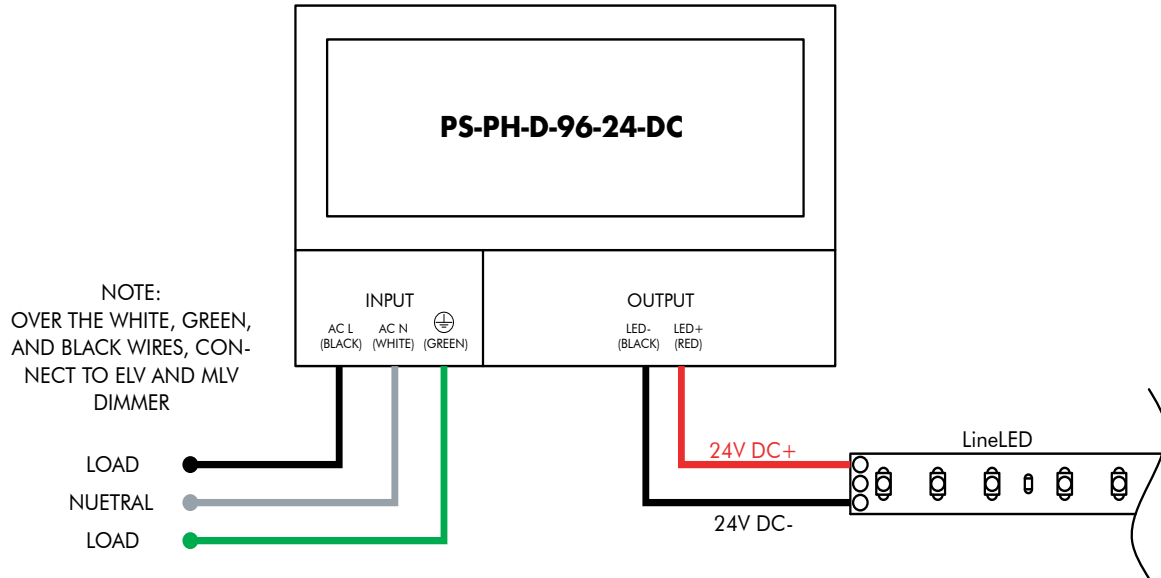

5

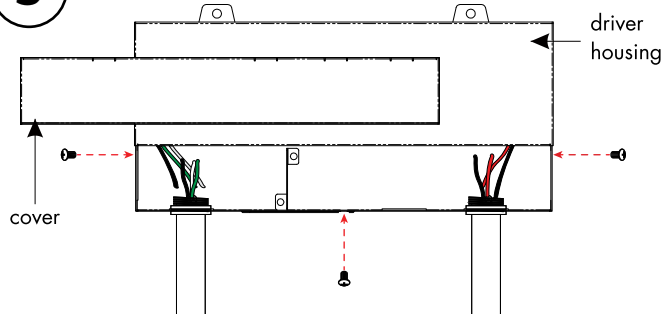

5.1 Insert the wire nut connections in the driver housing and close housing cover. Secure by tightening the three screws.