

PS-BA-UNI-D-XX-24 Basics Power Supply - Installation Instructions

Model PS-BA-UNI-D-30-24, PS-BA-UNI-D-60-24, PS-BA-UNI-D-96-24

Please read all instructions prior to installation and keep for future reference!

This power supply is to be installed in accordance with Article 450 of the National Electrical Code. The power supply must be installed in a well ventilated area and free from explosive gases and vapors. Proper operation requires the free flow of air. As this power supply is hardwired, it should be installed by a qualified electrician. UL class 2 recognized




REV.0.4
04242025


1 / 2

bbasics
by luminii

7777 Merrimac Ave
Niles, IL 60714
T 224.333.6033
F 224.757.7557
info@luminii.com
www.luminii.com

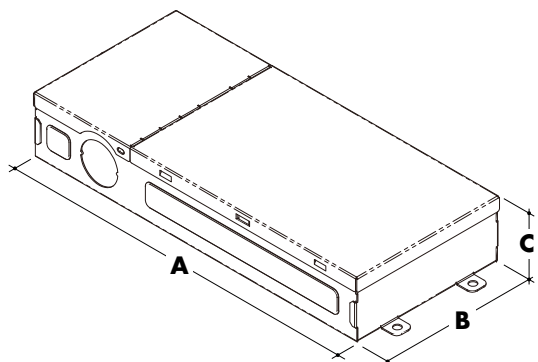


MODELS	PS-BA-UNI-D-30-24	PS-BA-UNI-D-60-24
MAX Load	30 watts	60 watts
A. Length	6.10"	7.93"
B. Width	3.35"	3.35"
C. Depth	1.33"	1.32"
Net Weight	1.1 lbs	1.87 lbs

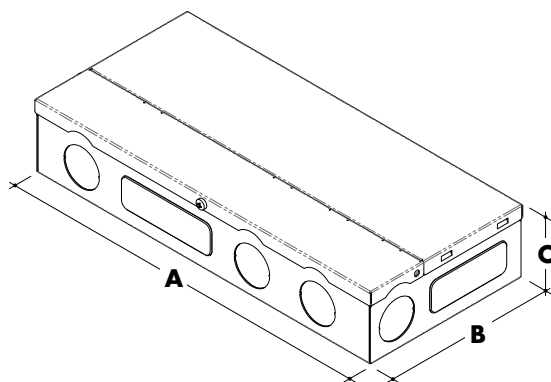

MODELS	PS-BA-UNI-D-96-24
MAX Load	96 watts
A. Length	8.29"
B. Width	4.10"
C. Depth	1.59"
Net Weight	2.20 lbs


1

Before installing, check the label and ensure the power supply has the proper input voltage, output voltage, and wattage for the job. Check the wire markings to ensure they match the wiring diagram below. Refer to table above for the maximum loads!

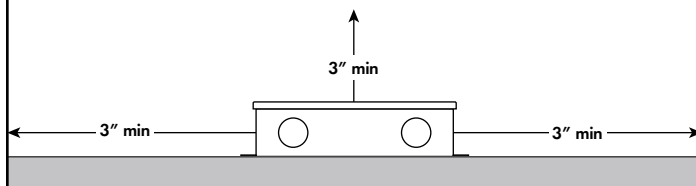

- 1.1** Power supply can be mounted vertically or horizontally. With a minimum of 3" clearance around power supply to provide proper air circulation.

2

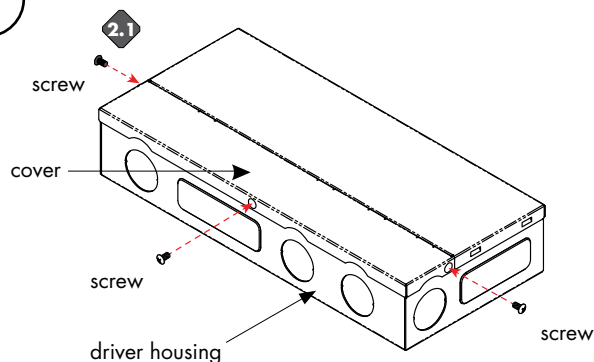

- 2.1** Remove the three Phillips screws from the top of the driver housing and pull the cover off to expose the driver wires.

PS-BA-UNI-D-XX-24 Basics Power Supply - Installation Instructions

Model PS-BA-UNI-D-30-24, PS-BA-UNI-D-60-24, PS-BA-UNI-D-96-24

Please read all instructions prior to installation and keep for future reference!

This power supply is to be installed in accordance with Article 450 of the National Electrical Code. The power supply must be installed in a well ventilated area and free from explosive gases and vapors. Proper operation requires the free flow of air. As this power supply is hardwired, it should be installed by a qualified electrician. UL class 2 recognized



REV.0.4
04242025

2 / 2

Bbasics
by luminii

7777 Merrimac Ave
Niles, IL 60714
T 224.333.6033
F 224.757.7557
info@luminii.com
www.luminii.com

